



PUG

REGULAMENT LOCAL DE URBANISM COMUNA BRANESTI REGLEMENTARI PE U.T.R. - SCARA 1:5000



Brănești

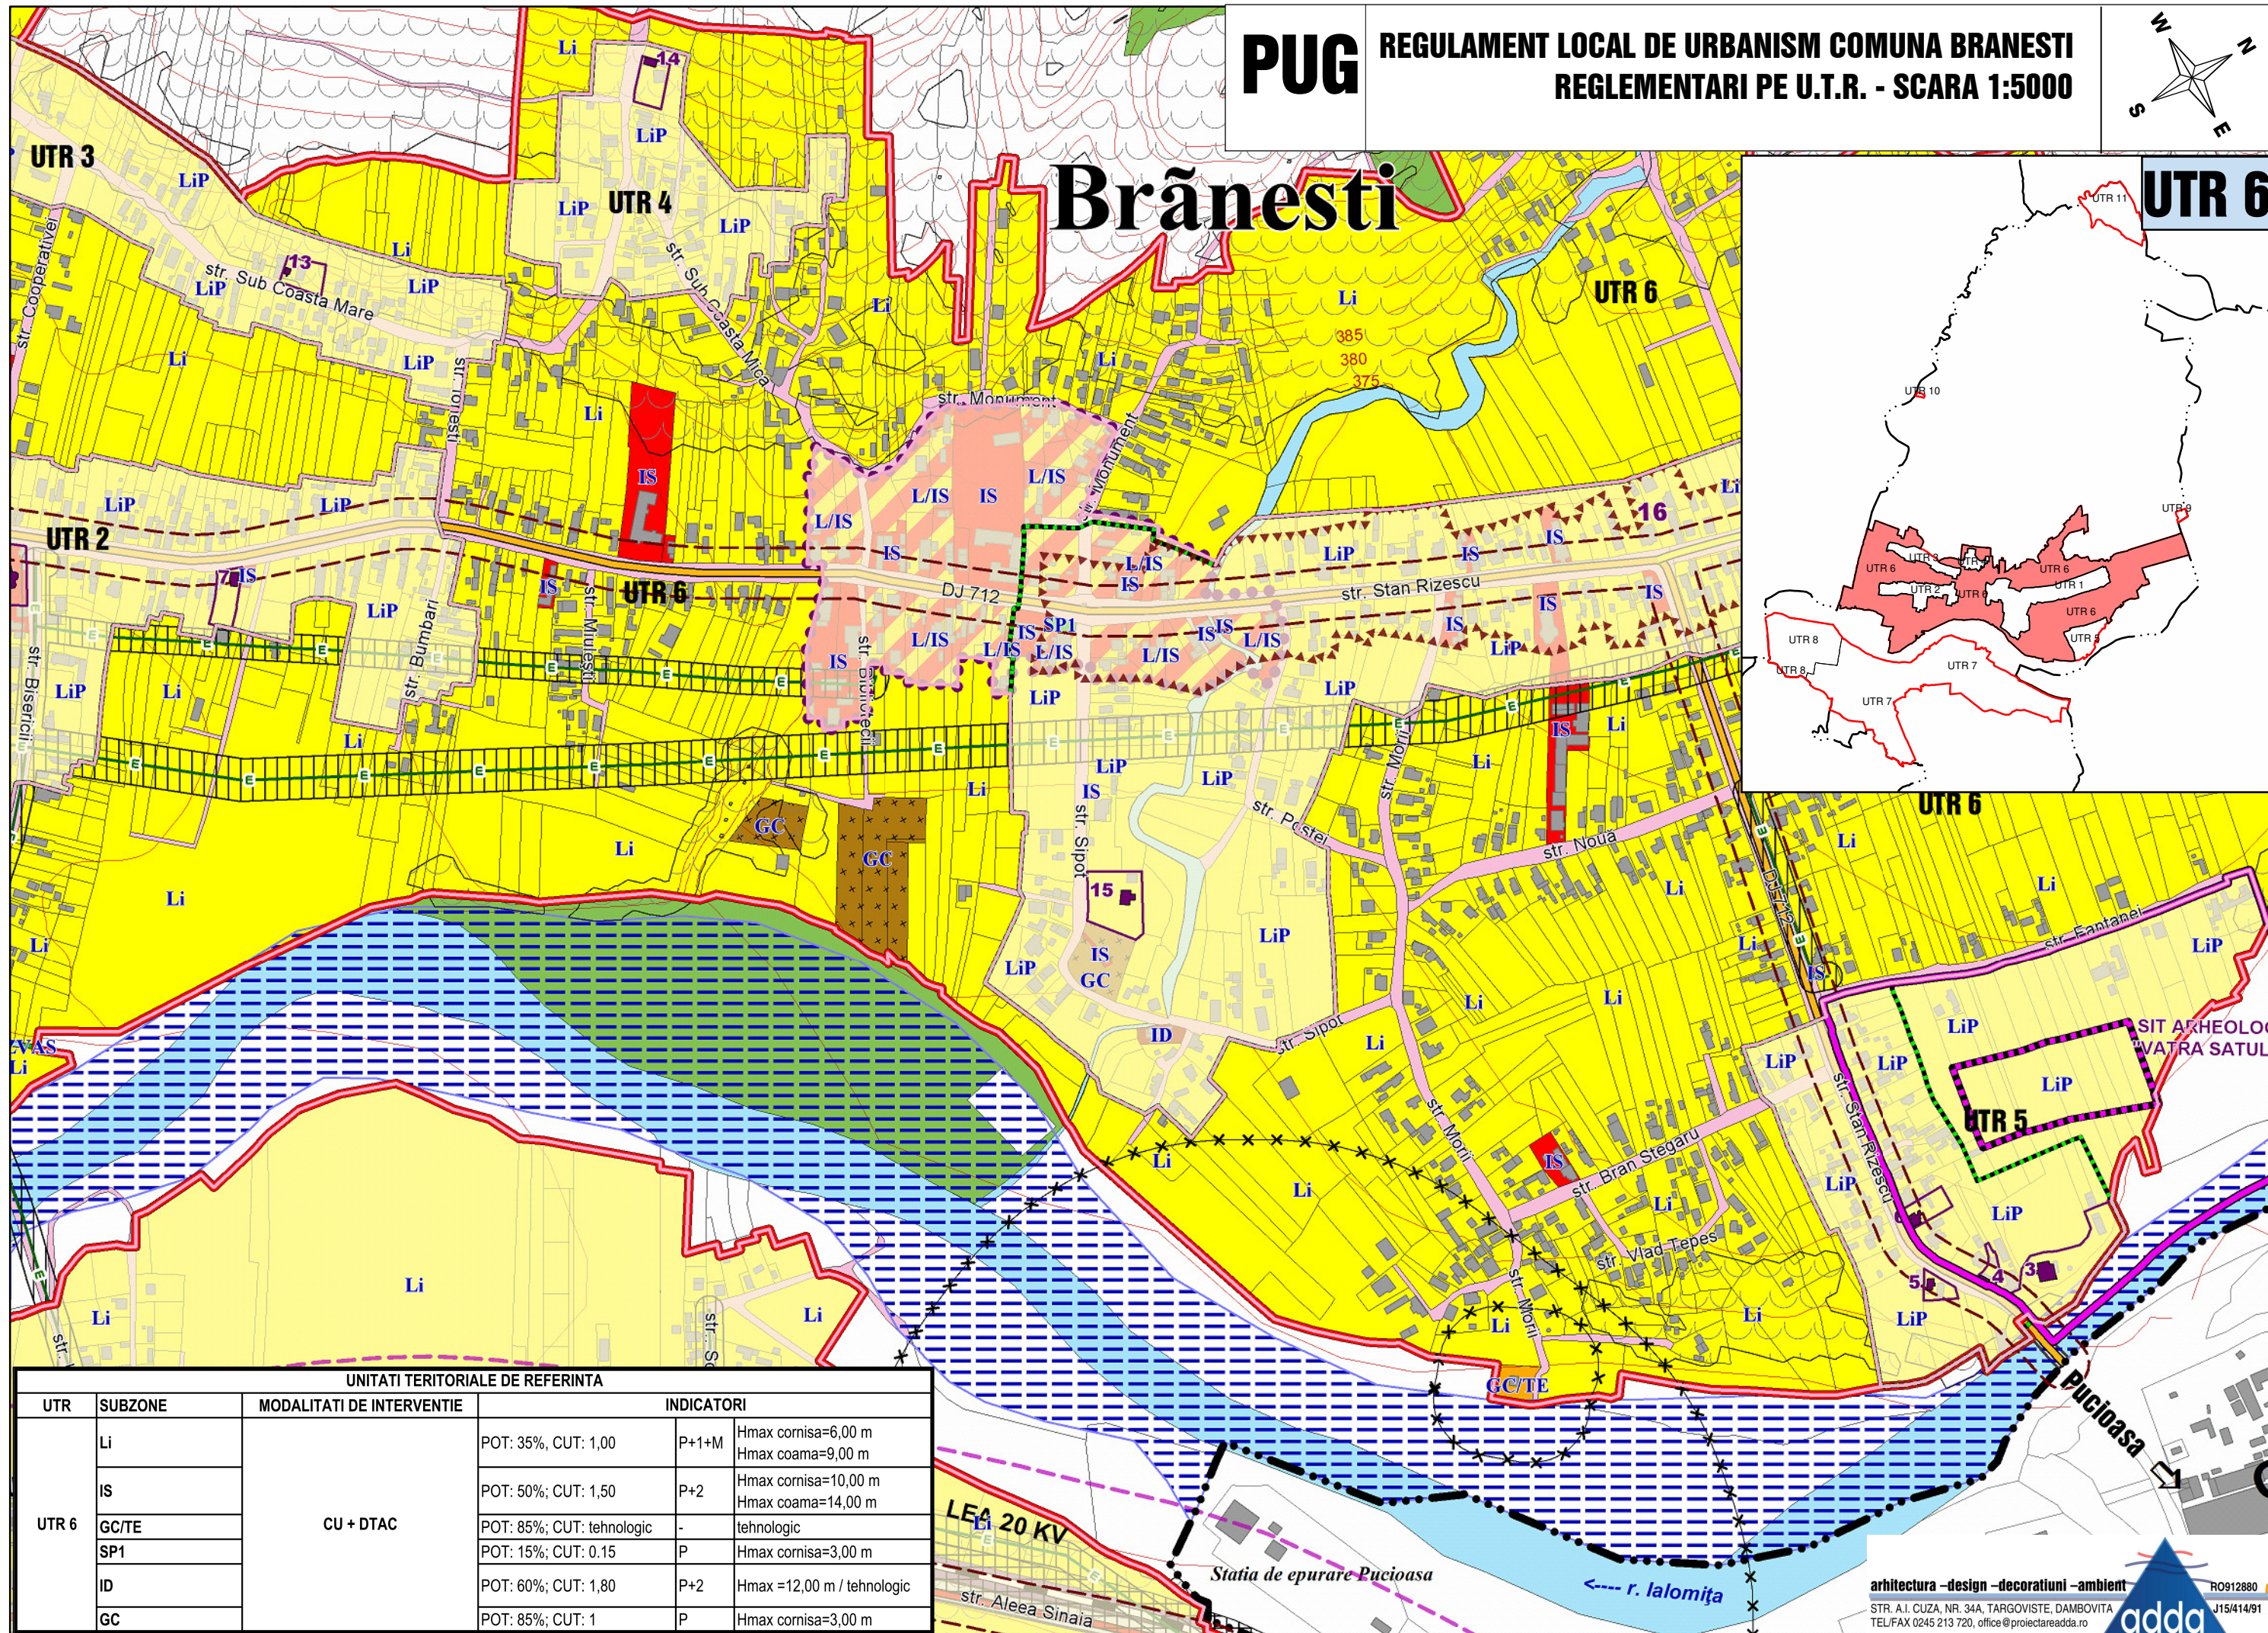

UNITATI TERRITORIALE DE REFERINTA					
UTR	SUBZONE	MODALITATI DE INTERVENTIE	INDICATORI		
UTR 6	Li	CU + DTAC	POT: 35%; CUT: 1,00	P+1+M	Hmax cornisa=6,00 m Hmax coama=9,00 m
	IS		POT: 50%; CUT: 1,50	P+2	Hmax cornisa=10,00 m Hmax coama=14,00 m
	GC/TE		POT: 85%; CUT: tehnologic	-	tehnologic
	SP1		POT: 15%; CUT: 0.15	P	Hmax cornisa=3,00 m
	ID		POT: 60%; CUT: 1,80	P+2	Hmax =12,00 m / tehnologic
	GC		POT: 85%; CUT: 1	P	Hmax cornisa=3,00 m