



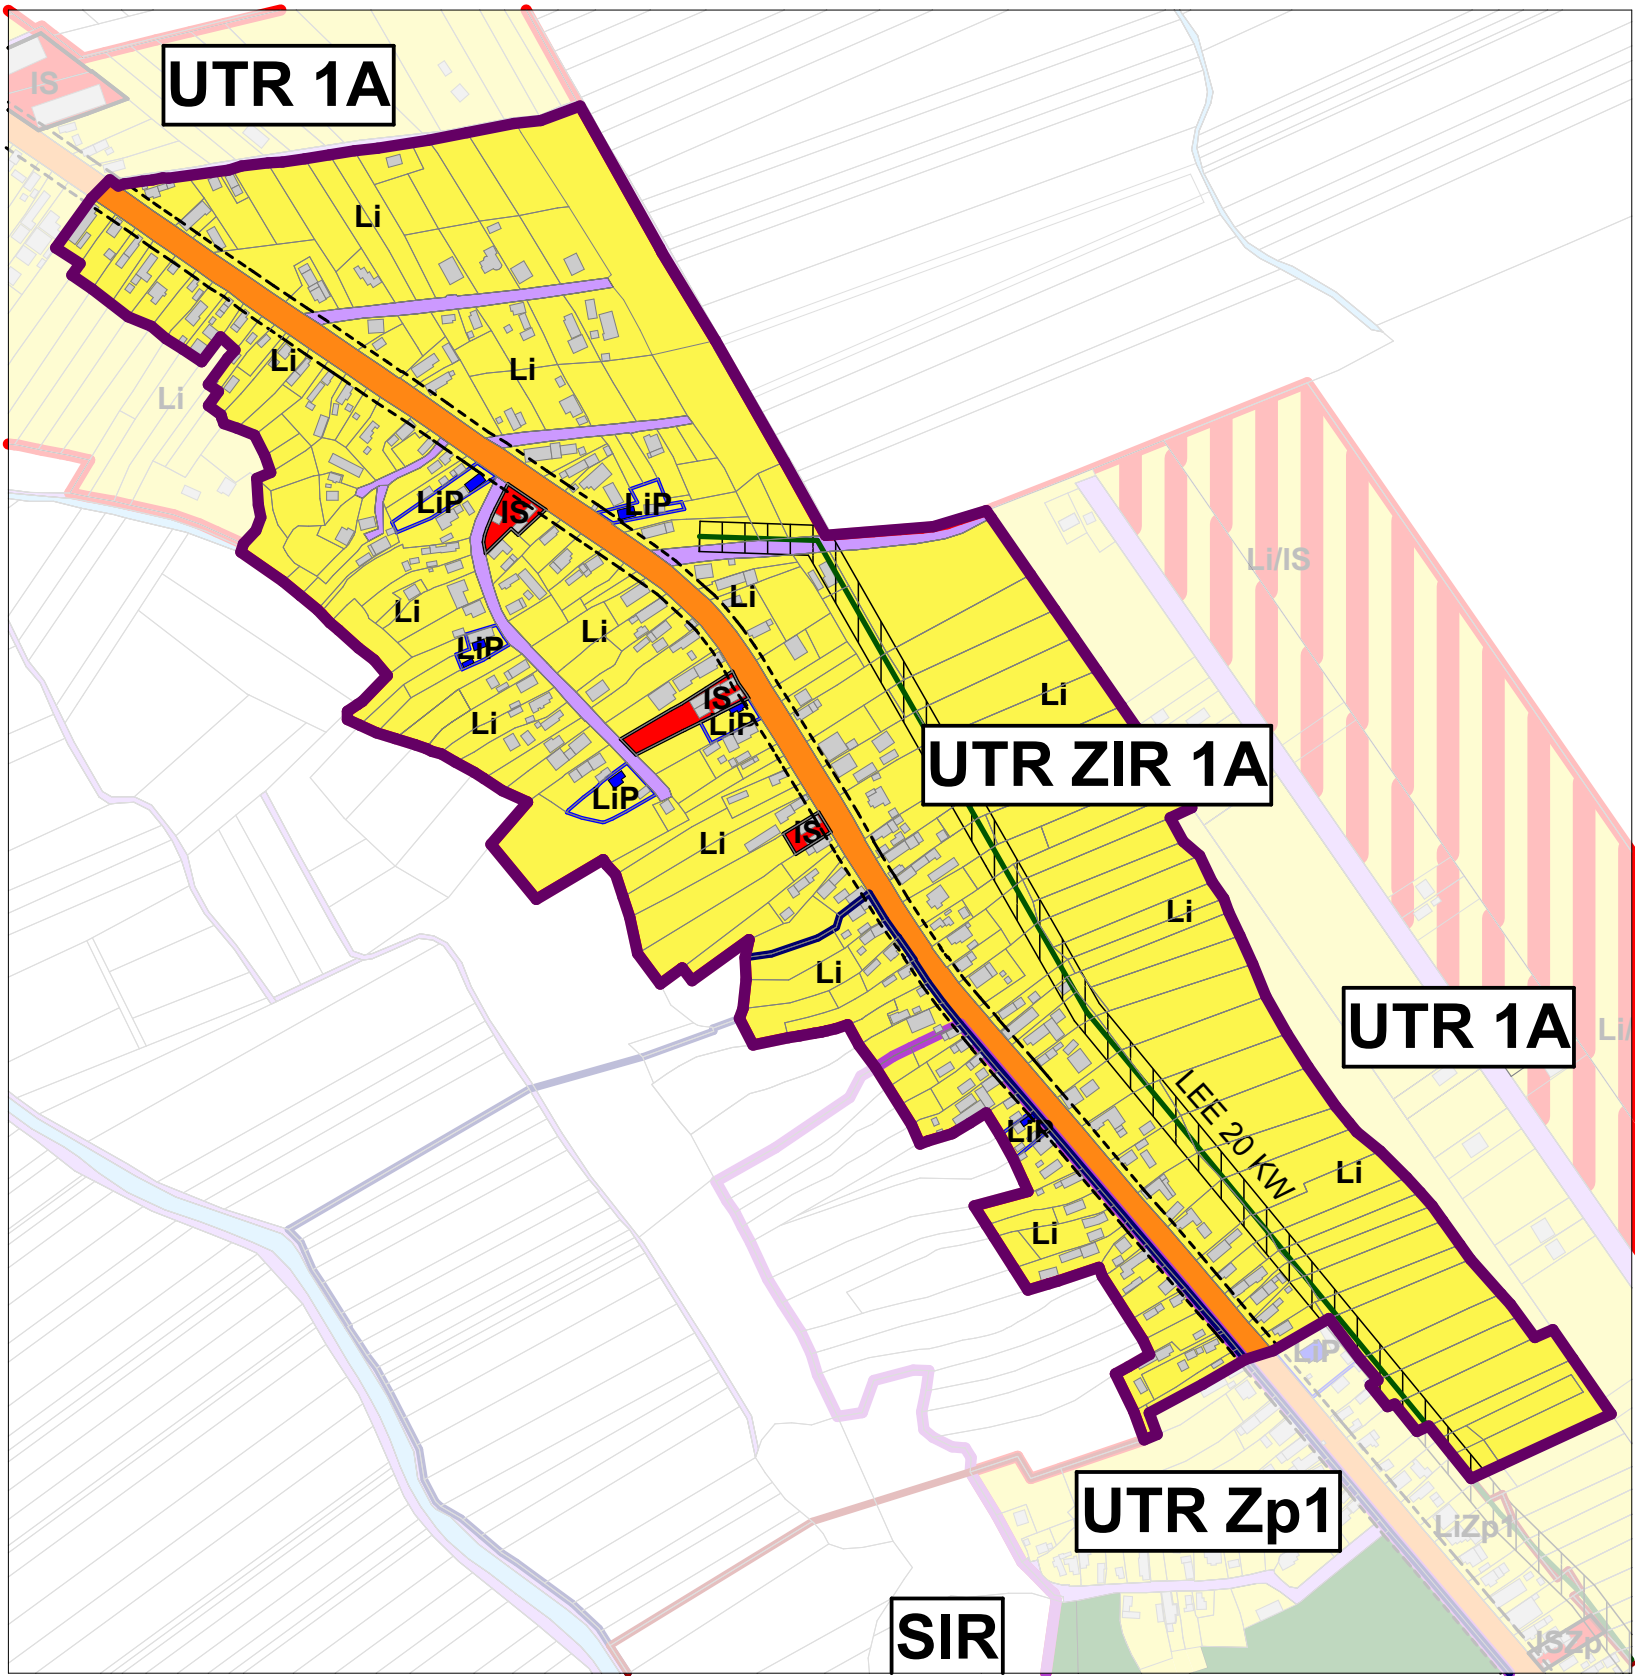

UNITATI TERITORIALE DE REFERINTA				
UTR	SUBZONE	INDICATORI		
UTR ZIR 1 ZONA ISTORICA DE REFERINTA A SATULUI VACARESTI	Li	POT: 35%, CUT: 1,05	P+2	Hmax comisa=9,00 m Hmax coama=12,00 m
	LiP	POT: 30%, CUT: 0,60	P+M	Hmax comisa=6,00 m Hmax coama=8,00 m
	IS	POT: 50%, CUT: 1,50	P+2	Hmax comisa=10,00 m Hmax coama=15,00 m
	ISp (cladire cu valoare ambiental)	POT: 30%, CUT: 0,60	P+M	Hmax comisa=5,00 m Hmax coama=8,00 m
	DS			
	ID	POT: 60%, CUT: 1,80	P+2	Hmax comisa=12,00 m/teh Hmax coama=15,00 m/teh
	GC	POT: 50%, CUT: 1,00	P	Hmax comisa=3,00 m; Hmax coama=5,00 m.
	V1	POT: 50%, CUT: tehnologic	tehnologic	Hmax comisa= tehnologic; Hmax coama= tehnologic

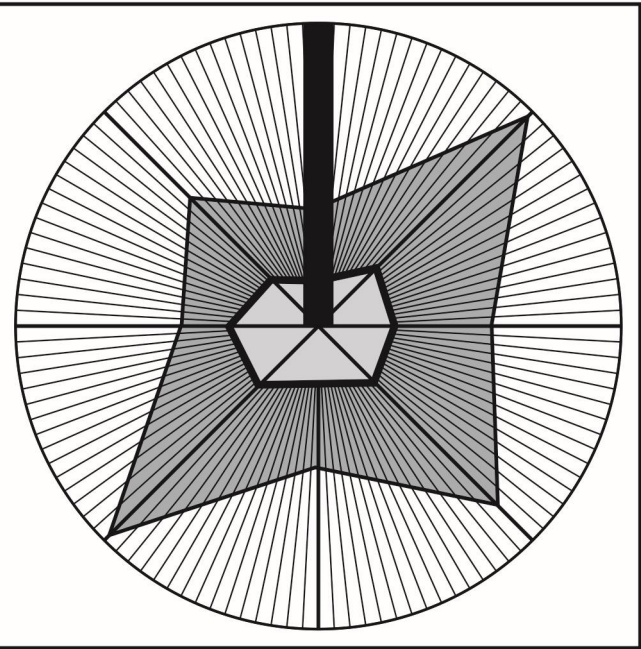